


Wall details shown for information only, not for construction issue

Please note:  
Wall build up to be certified by others.

For detailed view A,B,C please refer to the final page of this document.



|  |          |
|--|----------|
| FIRE RATING  | EI30     |
| FIRE STOPPING  | INCLUDED |
| ACOUSTIC RATING  | N/A      |
| Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection. |          |

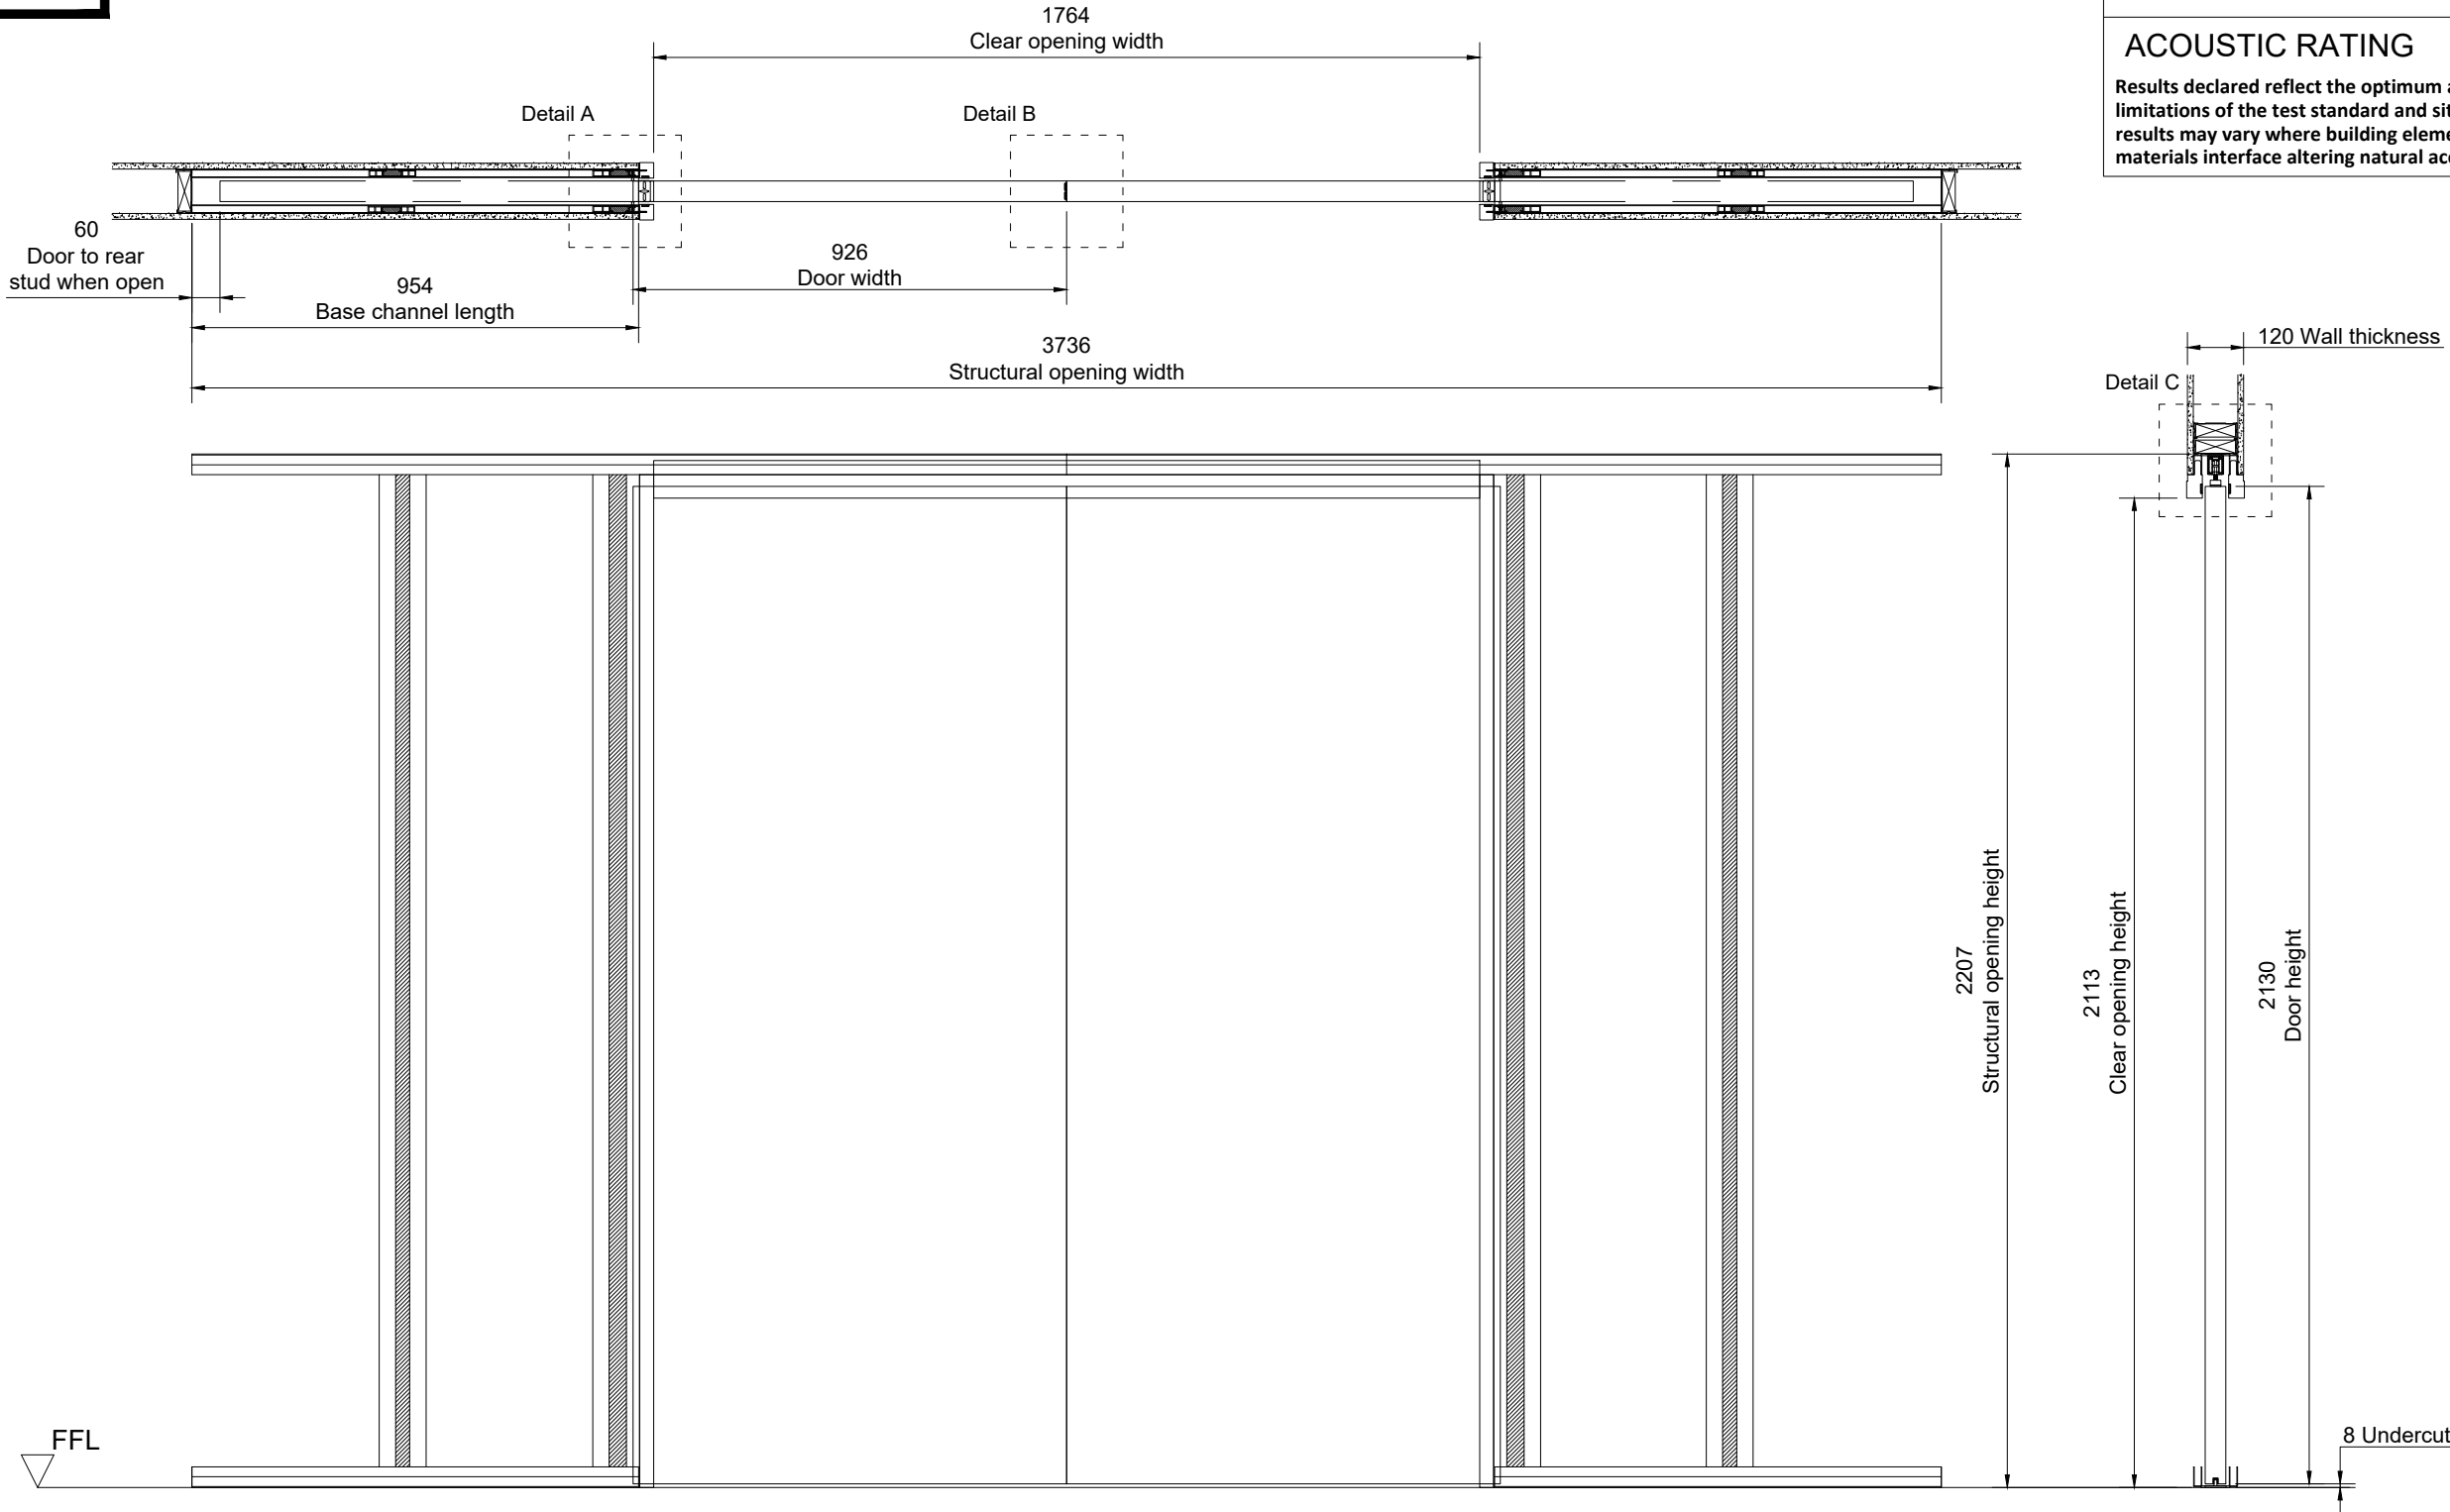

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists. Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Outside of these minimum dimensions specific fire test evidence should be sought. All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT sales@enigmapocketdoors.com

**Pocket kit suitable for doors within the following size ranges:**  
400-926mm wide and up to 2130mm high.


|      |              |             |          |   |    |           |              |   |     |   |                  |          |
|------|--------------|-------------|----------|---|----|-----------|--------------|---|-----|---|------------------|----------|
|      |              |             |          | Please report errors and omissions  |    | MATERIAL: | N/A          | FINISH:                                     | N/A | COLOUR:   | N/A              |          |
|      |              |             |          | Remove all burrs and sharp edges.   |    | PROJECT:  | ENIGMA       |   |     | TOLERANCES IN mm<br>UNLESS OTHERWISE NOTED  |                  |          |
|      |              |             |          | DRAWN:  | CK | 16/08/22  | INT DWG NO:  | SEL-PRT-10130                               |     |   | X                | ± 1      |
|      |              |             |          | CHECKED:  |    |           | EXT DWG NO:  | SEL-DRW-PRD-ENIG-2503                       |     |   | X.X              | ±0.5     |
|      |              |             |          | APPROVED:   |    |           | DESCRIPTION: | Enigma Visible EI30 Double Kit<br>400-926mm |     |   | ANGULAR          | ±0.5 DEG |
| A    | First Issue. | CK          | 16/08/22 |  |    |           |              | DO NOT SCALE PRINT                          |     |   |                  |          |
| REV: | COMMENT:     | REVISED BY: | DATE:    |   |    |           |              | MILLIMETERS                                 |     |  | REV.<br><b>A</b> |          |
|      |              |             |          |   |    |           |              |   |     |   |                  |          |
|      |              |             |          |   |    |           |              | SCALE: 1:16 @ A3                            |     | SHEET: 1 OF 5   |                  |          |

Wall details shown for information only, not for construction issue

Please note:  
Wall build up to be certified by others.

For detailed view A,B,C please refer to the final page of this document.

|  |          |
|--|----------|
| FIRE RATING  | EI30     |
| FIRE STOPPING  | INCLUDED |
| ACOUSTIC RATING  | N/A      |
| Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection. |          |

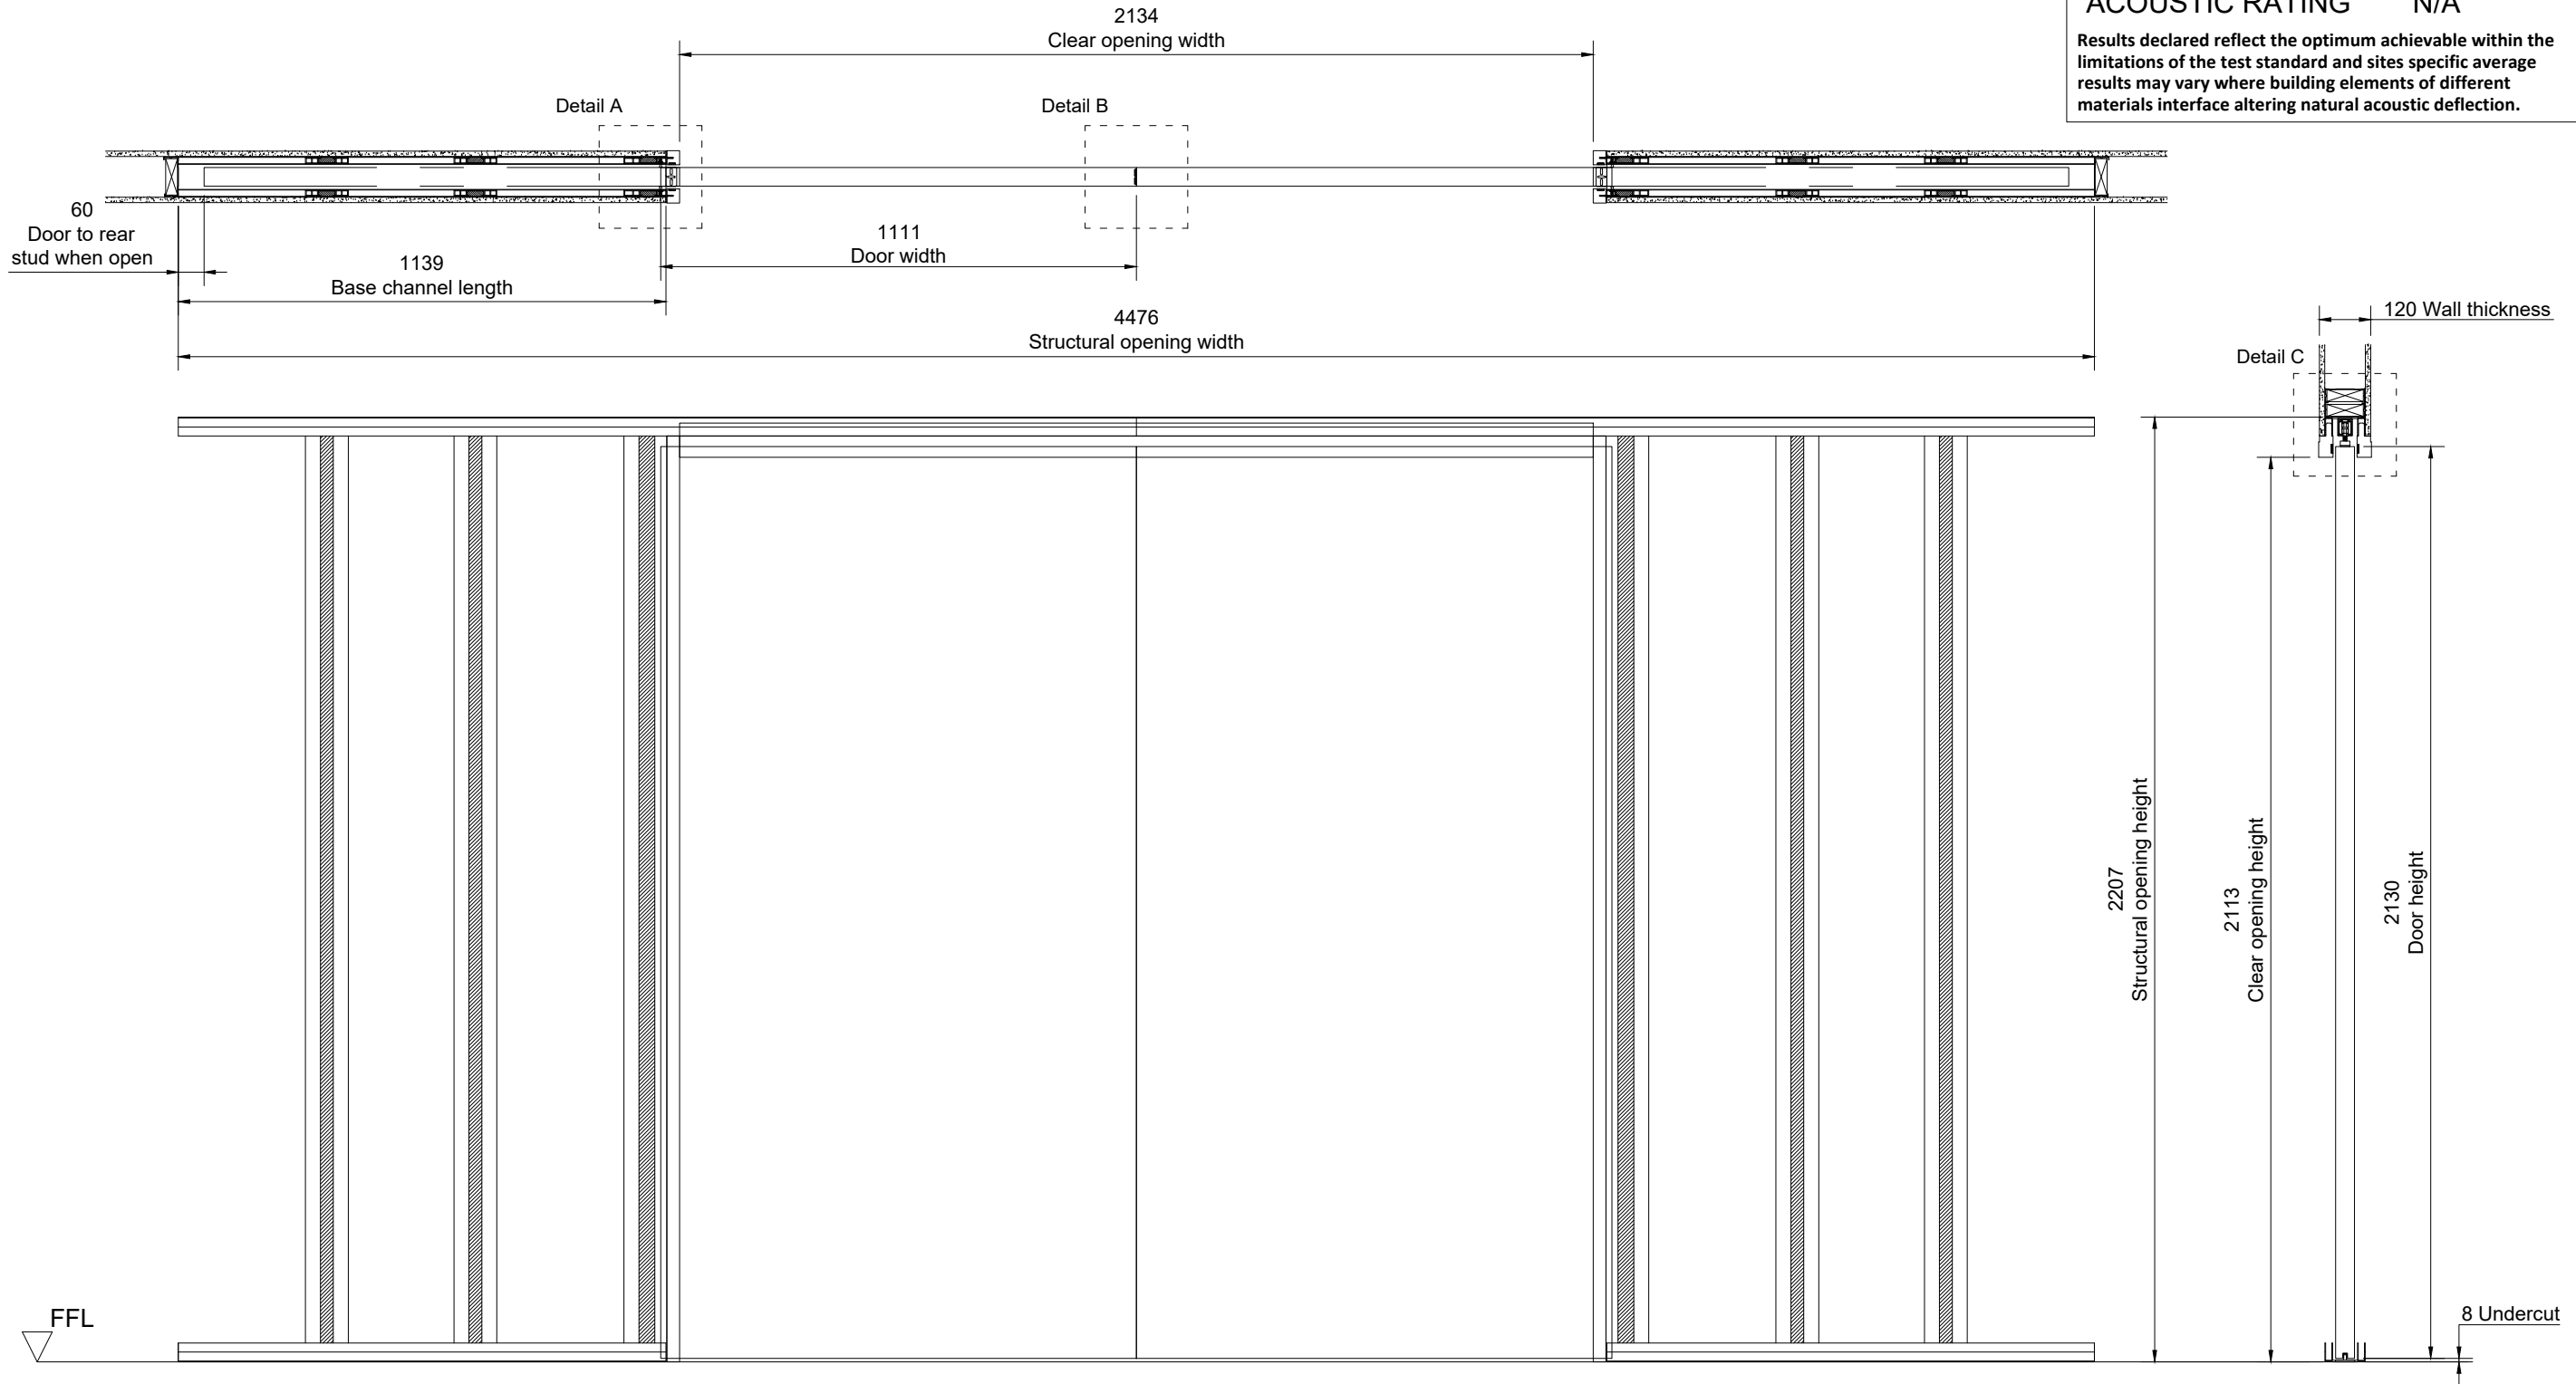

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists. Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Outside of these minimum dimensions specific fire test evidence should be sought. All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.


FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@enigmapocketdoors.com](mailto:sales@enigmapocketdoors.com)

**Pocket kit suitable for doors within the following size ranges:**  
**927-1111mm wide and up to 2130mm high.**

|      |              |             |          |   |    |           |              |  |     |         |  |                  |                    |
|------|--------------|-------------|----------|---|----|-----------|--------------|--|-----|---------|--|------------------|--------------------|
|      |              |             |          | Please report errors and omissions                |    | MATERIAL: | N/A          | FINISH:                                      | N/A | COLOUR: | N/A  |                  |                    |
|      |              |             |          | Remove all burrs and sharp edges.                 |    | PROJECT:  | ENIGMA       |  |     |         | TOLERANCES IN mm<br>UNLESS OTHERWISE NOTED |                  |                    |
|      |              |             |          | DRAWN:  | CK | 16/08/22  | INT DWG NO:  | SEL-PRT-10131                                |     |         |  | X ± 1            |                    |
|      |              |             |          | CHECKED:  |    |           | EXT DWG NO:  | SEL-DRW-PRD-ENIG-2503                        |     |         |  | X.X ±0.5         |                    |
|      |              |             |          | APPROVED:   |    |           | DESCRIPTION: | Enigma Visible EI30 Double Kit<br>927-1111mm |     |         |  | ANGULAR ±0.5 DEG |                    |
| A    | First Issue. | CK          | 16/08/22 | <div>ENIGMA</div> <div>SLIDING POCKET DOORS</div> |    |           |              | SCALE: 1:16 @ A3                             |     |         |  | SHEET: 2 OF 5    | DO NOT SCALE PRINT |
| REV: | COMMENT:     | REVISED BY: | DATE:    |   |    |           |              | MILLIMETERS                                  |     |         |  | REV.             | A                  |


Wall details shown for information only, not for construction issue

Please note:  
Wall build up to be certified by others.

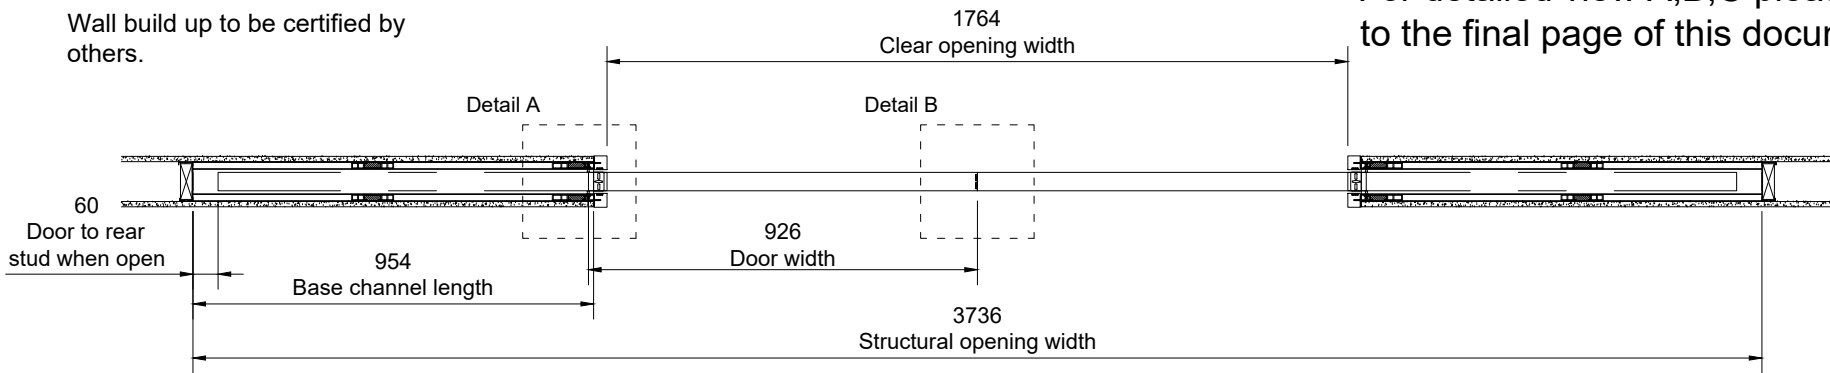

For detailed view A,B,C please refer to the final page of this document.

|  |          |
|--|----------|
| FIRE RATING  | EI30     |
| FIRE STOPPING  | INCLUDED |
| ACOUSTIC RATING  | N/A      |
| Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection. |          |

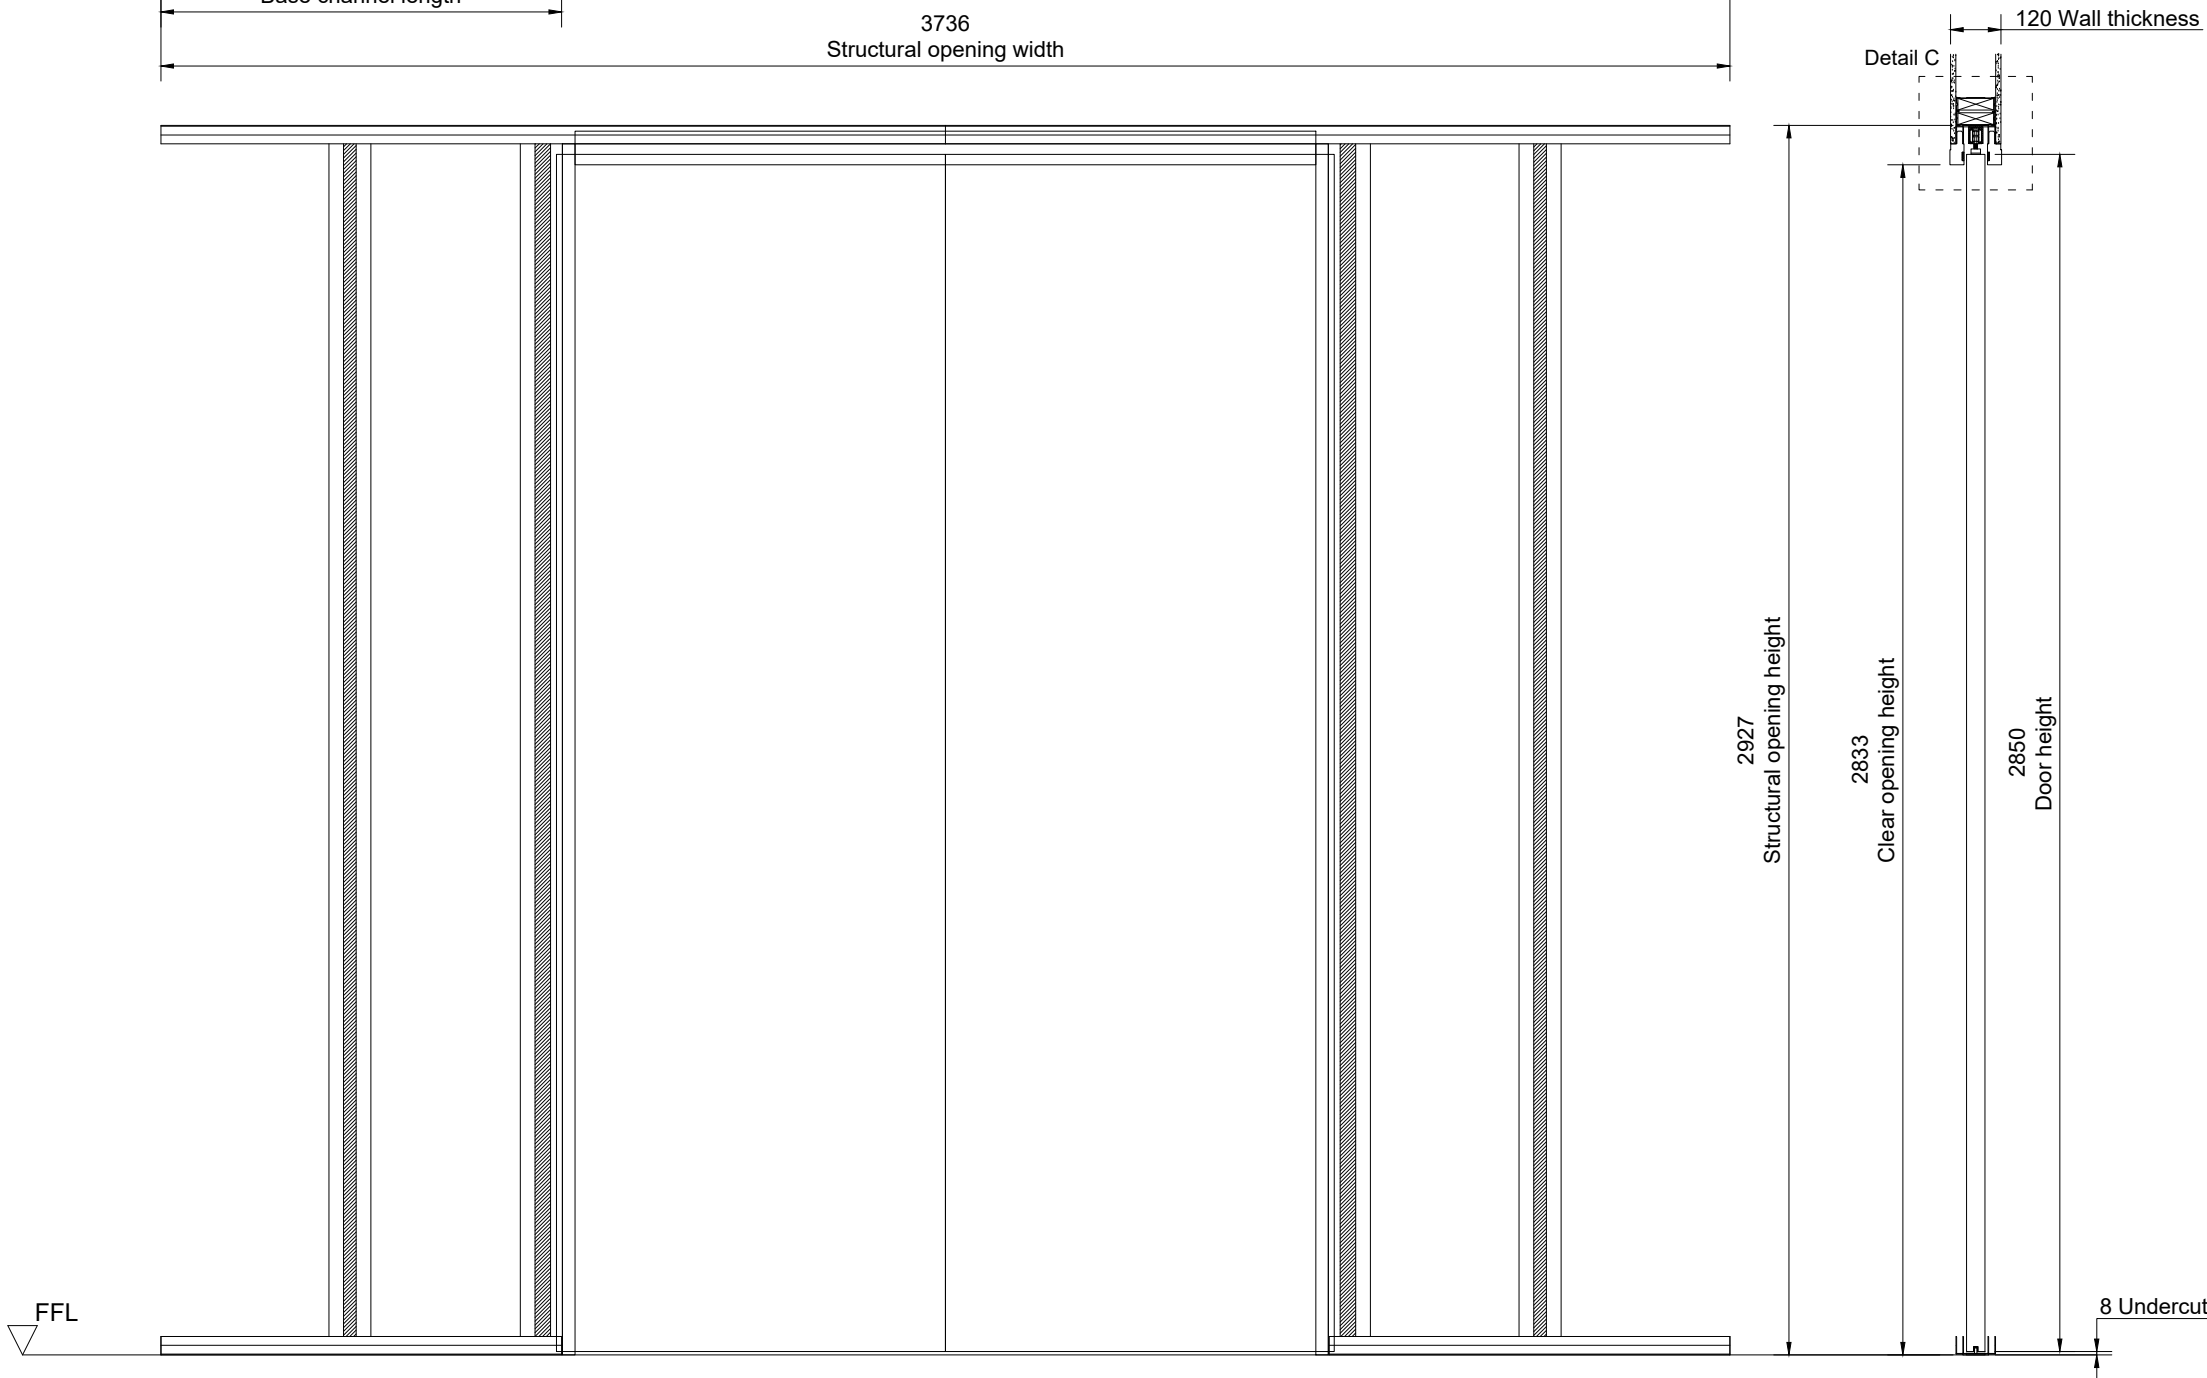

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists. Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Outside of these minimum dimensions specific fire test evidence should be sought.

All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT sales@enigmapocketdoors.com

**Pocket kit suitable for doors within the following size ranges:**  
**400-926mm wide and up to 2850mm high.**


|      |              |             |          |                                    |              |   |         |               |         |  |
|------|--------------|-------------|----------|------------------------------------|--------------|---|---------|---------------|---------|--|
|      |              |             |          | Please report errors and omissions | MATERIAL:    | N/A   | FINISH: | N/A           | COLOUR: | N/A  |
|      |              |             |          | Remove all burrs and sharp edges.  | PROJECT:     | ENIGMA  |         |               |         | TOLERANCES IN mm<br>UNLESS OTHERWISE NOTED |
|      |              |             |          | DRAWN: CK 16/08/22                 | INT DWG NO:  | SEL-PRT-10132                                 |         |               |         | X ± 1<br>X.X ±0.5<br>ANGULAR ±0.5 DEG      |
|      |              |             |          | CHECKED:                           | EXT DWG NO:  | SEL-DRW-PRD-ENIG-2503                         |         |               |         | DO NOT SCALE PRINT                         |
|      |              |             |          | APPROVED:                          | DESCRIPTION: | Enigma Visible Tall EI30 Double Kit 400-926mm |         |               |         | MILLIMETERS                                |
| A    | First Issue. | CK          | 16/08/22 |                                    |              | SCALE: 1:18 @ A3                              |         | SHEET: 3 OF 5 |         | REV. <b>A</b>                              |
| REV: | COMMENT:     | REVISED BY: | DATE:    |                                    |              |   |         |               |         |  |

Wall details shown for information only, not for construction issue

Please note:  
Wall build up to be certified by others.

For detailed view A,B,C please refer to the final page of this document.

|  |          |
|--|----------|
| FIRE RATING  | EI30     |
| FIRE STOPPING  | INCLUDED |
| ACOUSTIC RATING  | N/A      |
| Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection. |          |



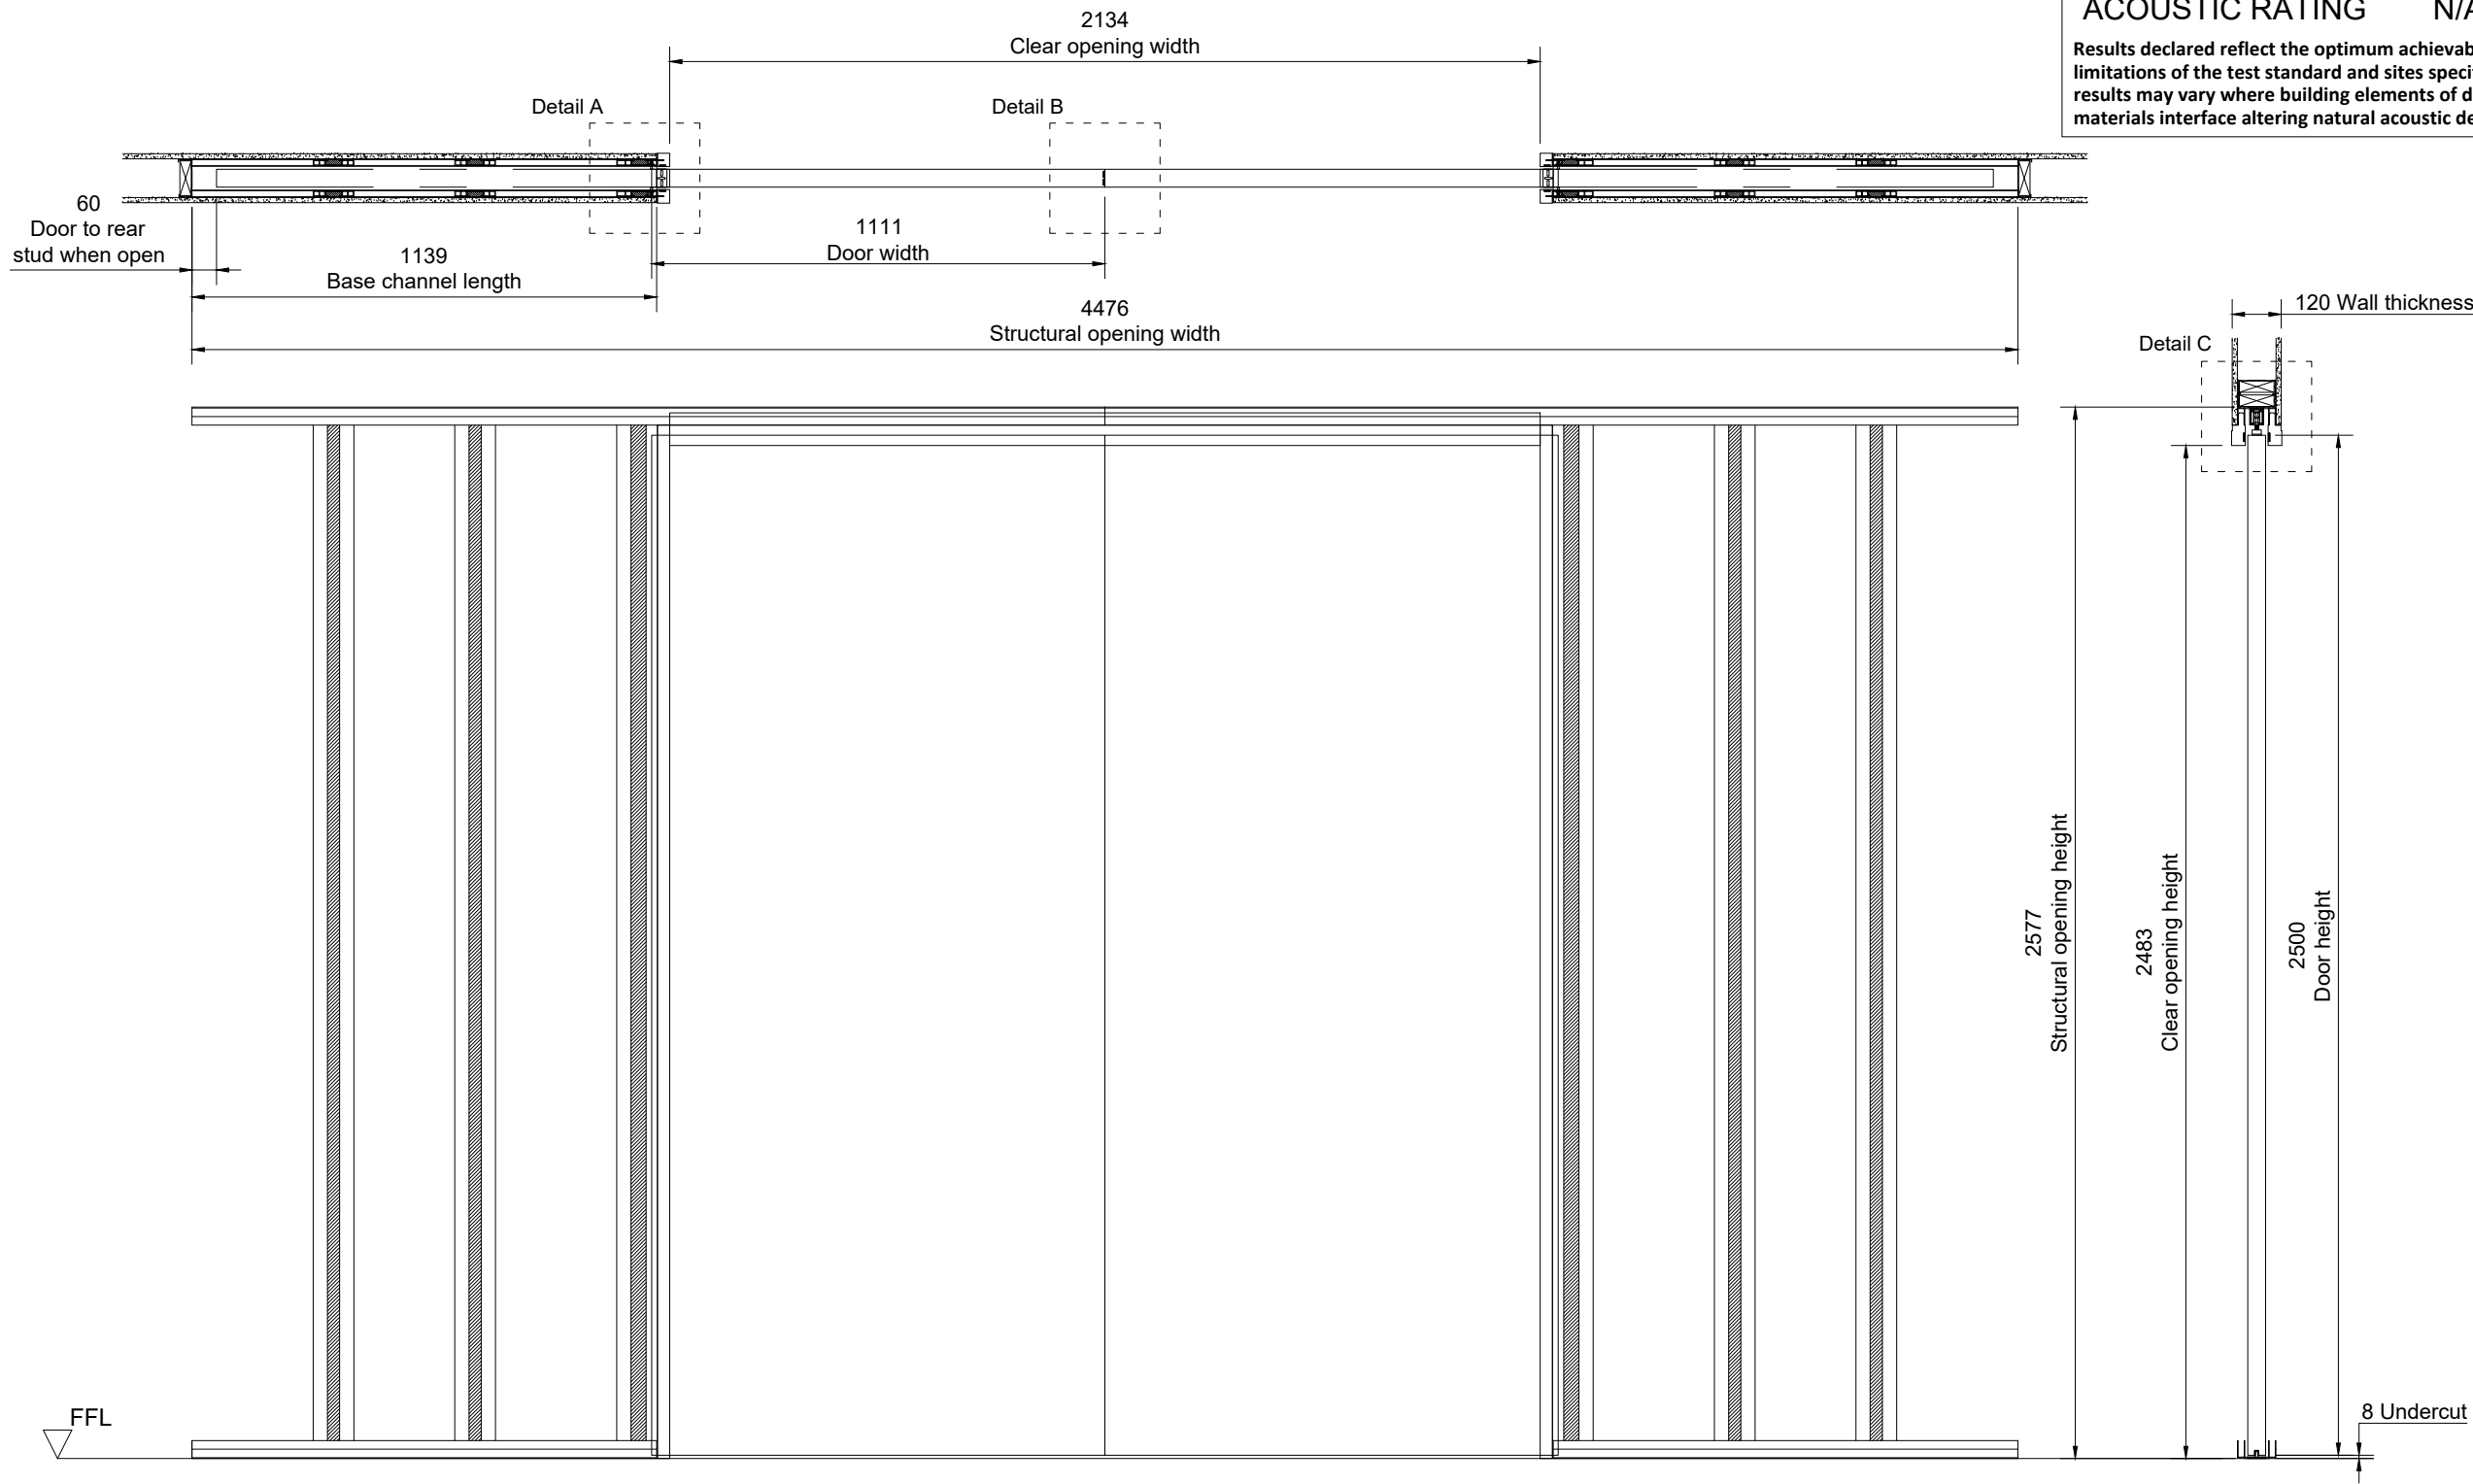


Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists. Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Outside of these minimum dimensions specific fire test evidence should be sought. All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT sales@enigmapocketdoors.com

**Pocket kit suitable for doors within the following size ranges:**  
**927-1111mm wide and up to 2500mm high.**

|      |              |             |          |                                    |              |  |           |        |         |  |
|------|--------------|-------------|----------|------------------------------------|--------------|--|-----------|--------|---------|--|
| A    | First Issue. | CK          | 16/08/22 | Please report errors and omissions | MATERIAL:    | N/A  | FINISH:   | N/A    | COLOUR: | N/A  |
|      |              |             |          | Remove all burrs and sharp edges.  | PROJECT:     | ENIGMA   |           |        |         | TOLERANCES IN mm<br>UNLESS OTHERWISE NOTED |
|      |              |             |          | DRAWN: CK 16/08/22                 | INT DWG NO:  | SEL-PRT-10133                                  |           |        |         | X ± 1<br>X.X ±0.5<br>ANGULAR ±0.5 DEG      |
|      |              |             |          | CHECKED:                           | EXT DWG NO:  | SEL-DRW-PRD-ENIG-2503                          |           |        |         | DO NOT SCALE PRINT                         |
|      |              |             |          | APPROVED:                          | DESCRIPTION: | Enigma Visible Tall EI30 Double Kit 927-1111mm |           |        |         | MILLIMETERS                                |
| REV: | COMMENT:     | REVISED BY: | DATE:    | ENIGMA SLIDING POCKET DOORS        |              | SCALE:   | 1:18 @ A3 | SHEET: | 4 OF 5  | REV. A                                     |

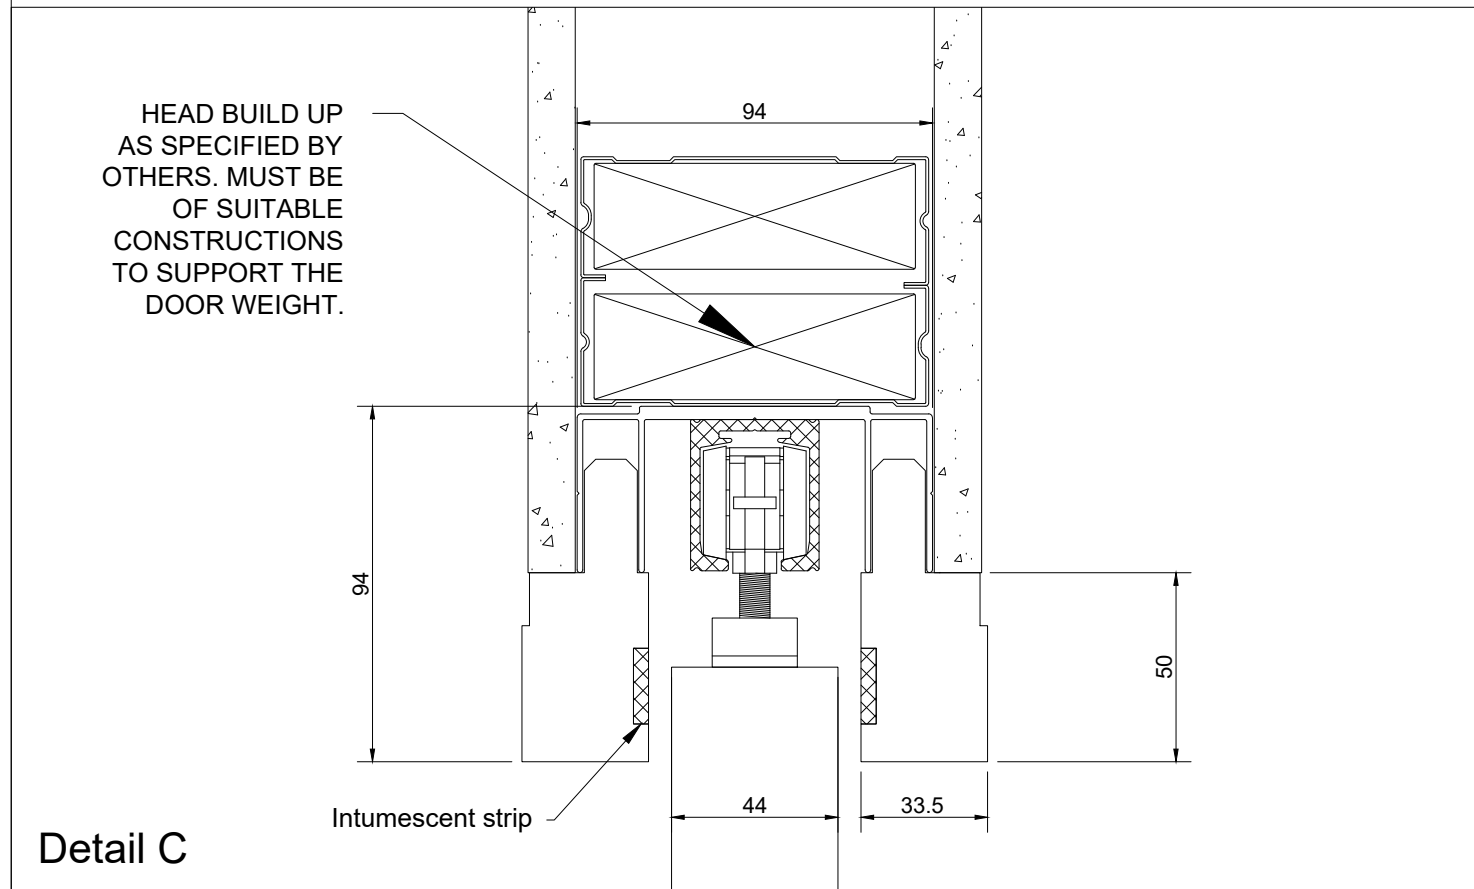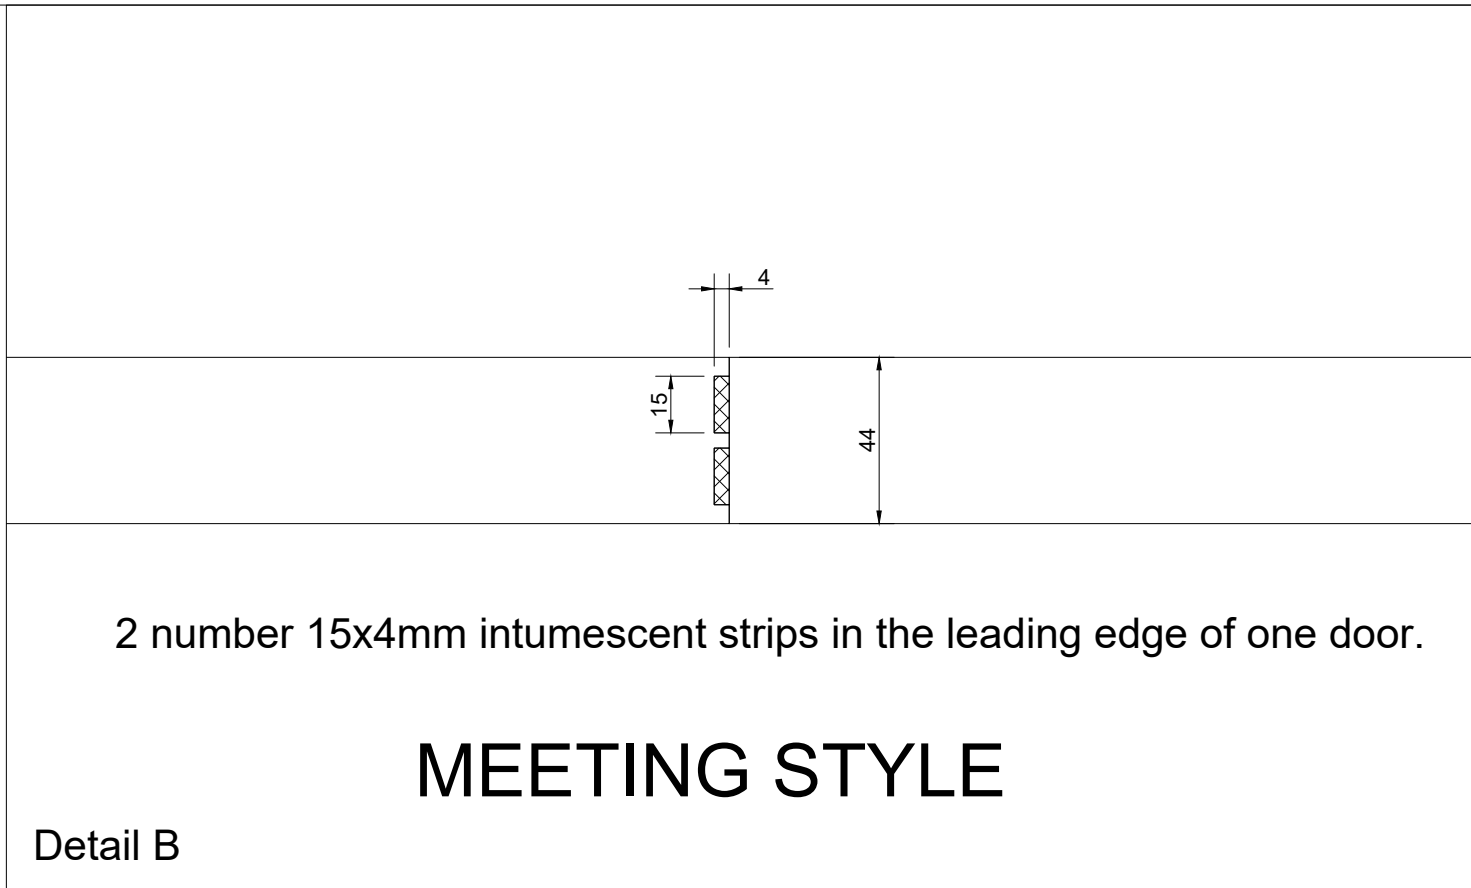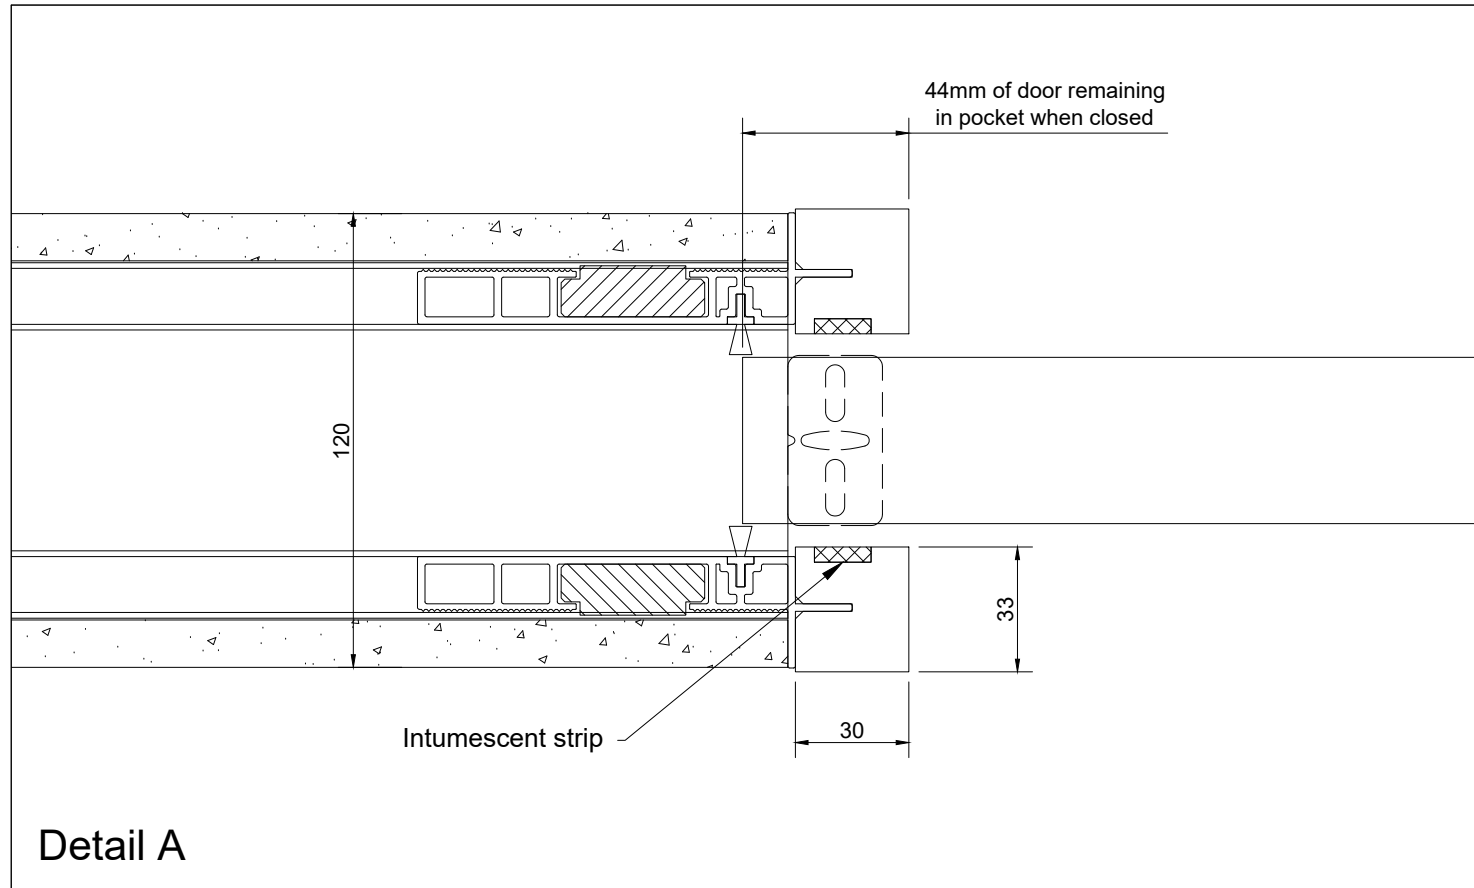

Wall details shown for information only, not for construction issue

Please note:  
Wall build up to be certified by others.

|  |          |
|--|----------|
| FIRE RATING  | EI30     |
| FIRE STOPPING  | INCLUDED |
| ACOUSTIC RATING  | N/A      |
| Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection. |          |

|      |              |             |          |   |    |           |              |  |     |         |   |                    |
|------|--------------|-------------|----------|---|----|-----------|--------------|--|-----|---------|---|--------------------|
|      |              |             |          | Please report errors and omissions                |    | MATERIAL: | N/A          | FINISH:                                | N/A | COLOUR: | N/A   |                    |
|      |              |             |          | Remove all burrs and sharp edges.                 |    | PROJECT:  | ENIGMA       |  |     |         | TOLERANCES IN mm<br>UNLESS OTHERWISE NOTED<br>X ± 1<br>X.X ±0.5<br>ANGULAR ±0.5 DEG |                    |
|      |              |             |          | DRAWN:  | CK | 16/08/22  | INT DWG NO:  | N/A                                    |     |         |   |                    |
|      |              |             |          | CHECKED:  |    |           | EXT DWG NO:  | SEL-DRW-PRD-ENIG-2503                  |     |         |   |                    |
|      |              |             |          | APPROVED:   |    |           | DESCRIPTION: | Enigma Visible Double EI30 Kit Details |     |         |   |                    |
| A    | First Issue. | CK          | 16/08/22 | <div>ENIGMA</div> <div>SLIDING POCKET DOORS</div> |    |           |              | SCALE: 1:2 @ A3 SHEET: 5 OF 5          |     |         |   | DO NOT SCALE PRINT |
| REV: | COMMENT:     | REVISED BY: | DATE:    |   |    |           |              |  |     |         |   | MILLIMETERS        |